



IP67 SHORT CABLE GLAND


AXIAL (CODE 'Mxx'/'MQxx')

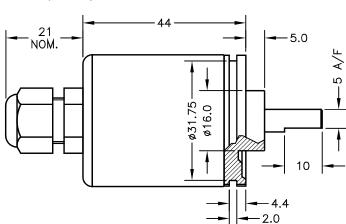


SERVO MOUNT (CODE 'P')

MARK IN BASE AT MID TRAVEL ±5"





GAIN AND OFFSET ADJUSTMENTS SEALED (CODE 'Y')



Е	li 0.2A WAS 0.46A - RAN266	PDM
F	ADDITIONAL DIMS/VIEWS ADDED.	PDM
G	DISP. 16 TO 160° WAS 20 TO 160° RAN442	PDM
Н	APPROVAL STANDARDS UPDATED - RAN465.	PDM
J	5-CORE OPTION ADDED ~ RAN1102	PDM
К	RANGE NOTE AMENDED ~ RAN1200	PDM

sensori & trasduttori

DRAWINGS NOT TO BE CHANGED WITHOUT REFERENCE TO THE CHANGE PROCEDURE. CHANGES TO PARTS USED IN INTRINSICALLY SAFE PRODUCT MUST BE APPROVED BY THE AUTHORISED PERSON THIS IS AN UNCONTROLLED PRINT AND WILL NOT BE UPDATED.

PSPM Industria Paolo Uccello 4 - 20148 Milano

CE

+39 02 48 009 757 Fax +39 02 48 002 070 info@dspmindustria.it www.dspmindustria.it

FLANGE BASE (STANDARD) 60 (¥ -2 OFF 4.5 SLOTS ±15' ON 48.0 PCD. (SYMMETRICAL) INCREASING O/P CALIBRATED SECTOR SHAFT FLAT ALIGNED WITH REFERENCE

ELECTRICAL OPTIONS/ SPECIFICATIONS <u>OUTPUT</u> SUPPLY 0.5 TO 4.5V RATIOMETRIC 5V SUPPLY CURRENT 12mA TYP. 20mA MAX. CABLE: 0.2mm², O/A SCREEN, PUR JACKET – SUPPLIED WITH 50cm OR REQUIRED LENGTH IN cm (15000cm MAX). STANDARD 3–CORE: JACKET Ø4mm BLACK e.g. 'L50' OPTIONAL 5–CORE: JACKET Ø4.6mm BLUE e.g. 'LQ50' CABLE/CONNECTOR* CONNECTIONS; 3 CORE 5 CORE CONNECTOR RED RED :1 +Ve +SENSE (5-WIRE ONLY) ORG :1 BLACK :3 BLACK 0٧ :3 GRY -SENSE (5-WIRE ONLY) WHITE :2 OUTPUT WHITE :4 SCREEN SCREEN BODY *CONNECTORS; MAXIMUM CONDUCTOR CROSS SECTION 0.75mm² RANGE OF DISPLACEMENT FROM 0-16° TO 0-160° e.g.76°, IN INCREMENTS OF 1'. BODY MATERIAL:- STAINLESS STEEL FLANGE BASE MATERIAL:- STAINLESS STEEL. SERVO MOUNT MATERIAL:- STAINLESS STEEL. FURTHER OPTIONS: SPRING RETURN (CODE 'N') AVAILABLE UP TO ±50°

CALIBRATED OUTPUT, PHYSICAL STOPS ±55" NOTE STANDARD DEVICE HAS NO STOPS.

FOR FULL INSTRUCTIONS FOR USE. ATEX / IECEX APPROVED TO **€** II 1G Ex ia IIC T4 Ga (Ta= -40° to +80°C) Ui 11.4V, Ii 0.2A, Pi 0.51W APPROVED FOR USE IN CONJUNCTION WITH A GALVANICALLY ISOLATED BARRIER. NOTE: APPROVAL ONLY APPLIES AT NORMAL ATMOSPHERIC PRESSURE!

> POSITEK LIMITED

Е	21/04/10		CHECKED BY	
F	06/07/11	\oplus	RDS	X.X ±0.2 X.XX ±0.1
G	07/11/13	Ч [¬]		DIMS mm
Н	11/03/14	DESCRIPTION		
J	27/04/17	X500 INTRINSICALLY SAFE		
Κ	11/09/17	ROTARY SENSOR		
scale 10mm K N				REV K T 1 OF 1